




Graph 1 - Discharge of Jeti Power-Ion 4S2P at 20 amps/9C.

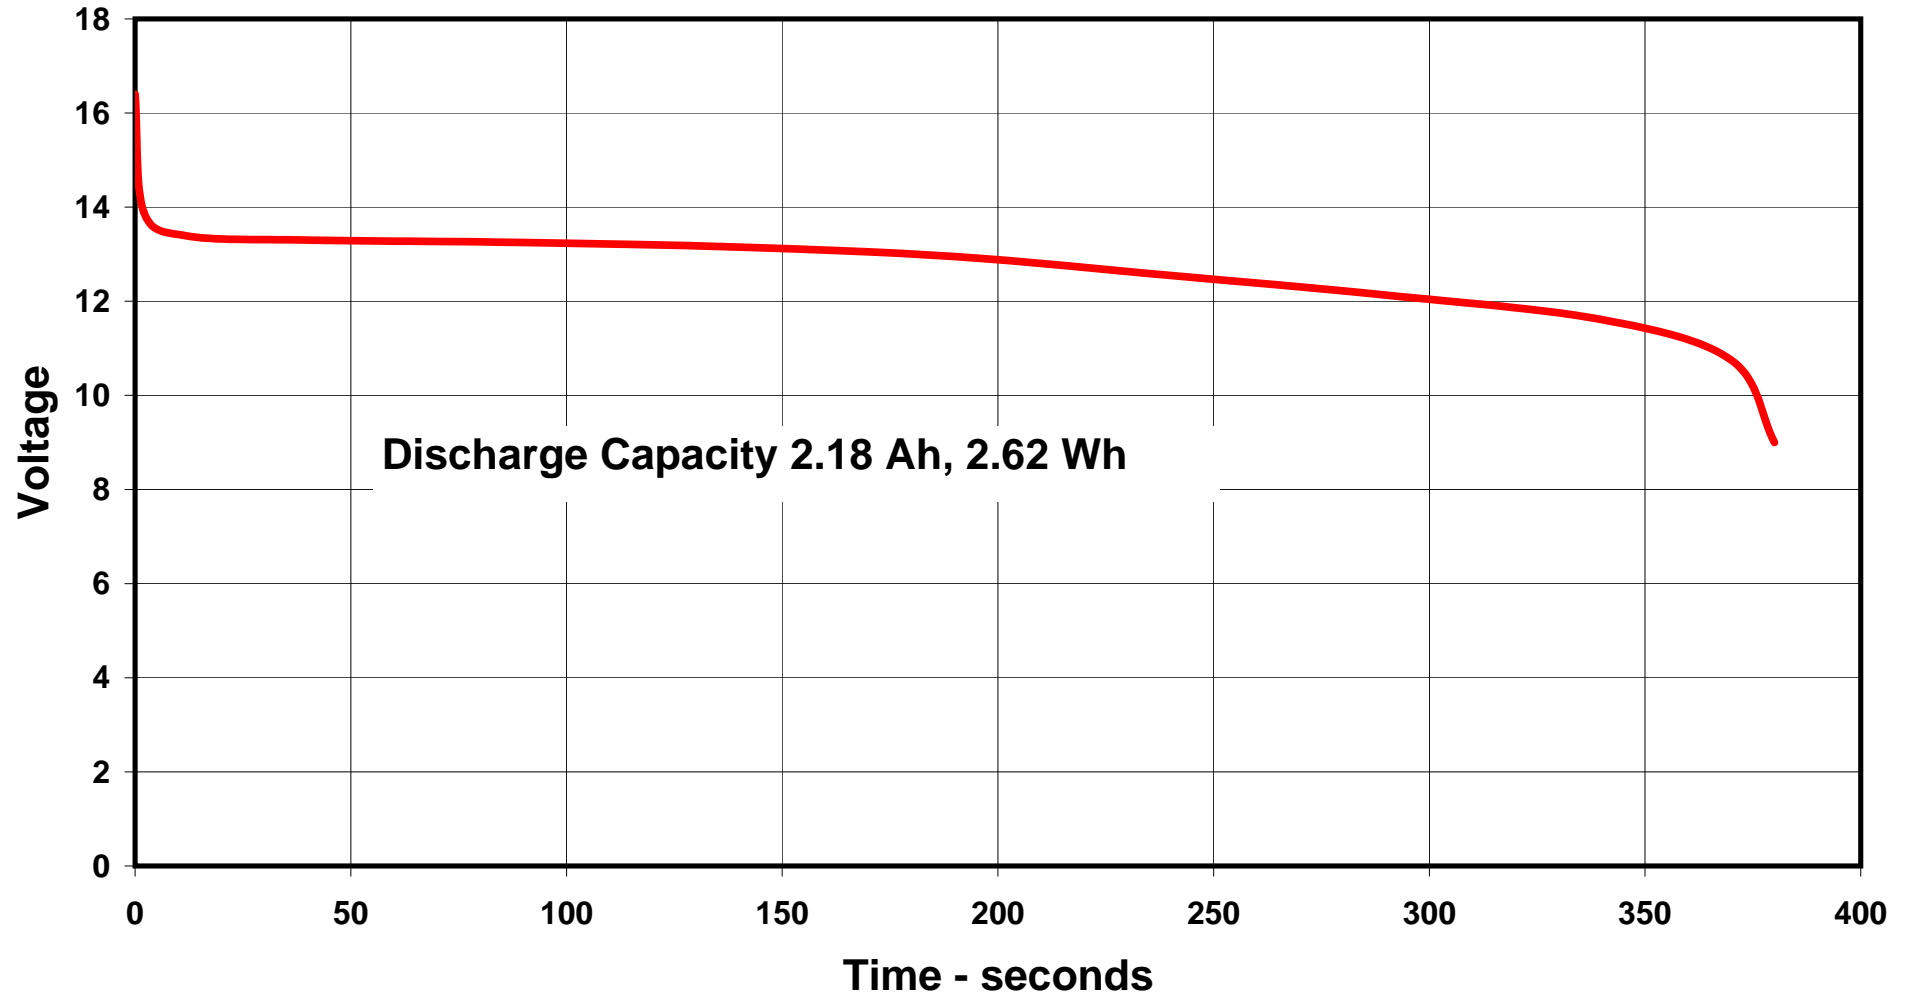


Graph 2 - Discharge of Overlander PolyPro 3300 3S pack at 50 amps/15C

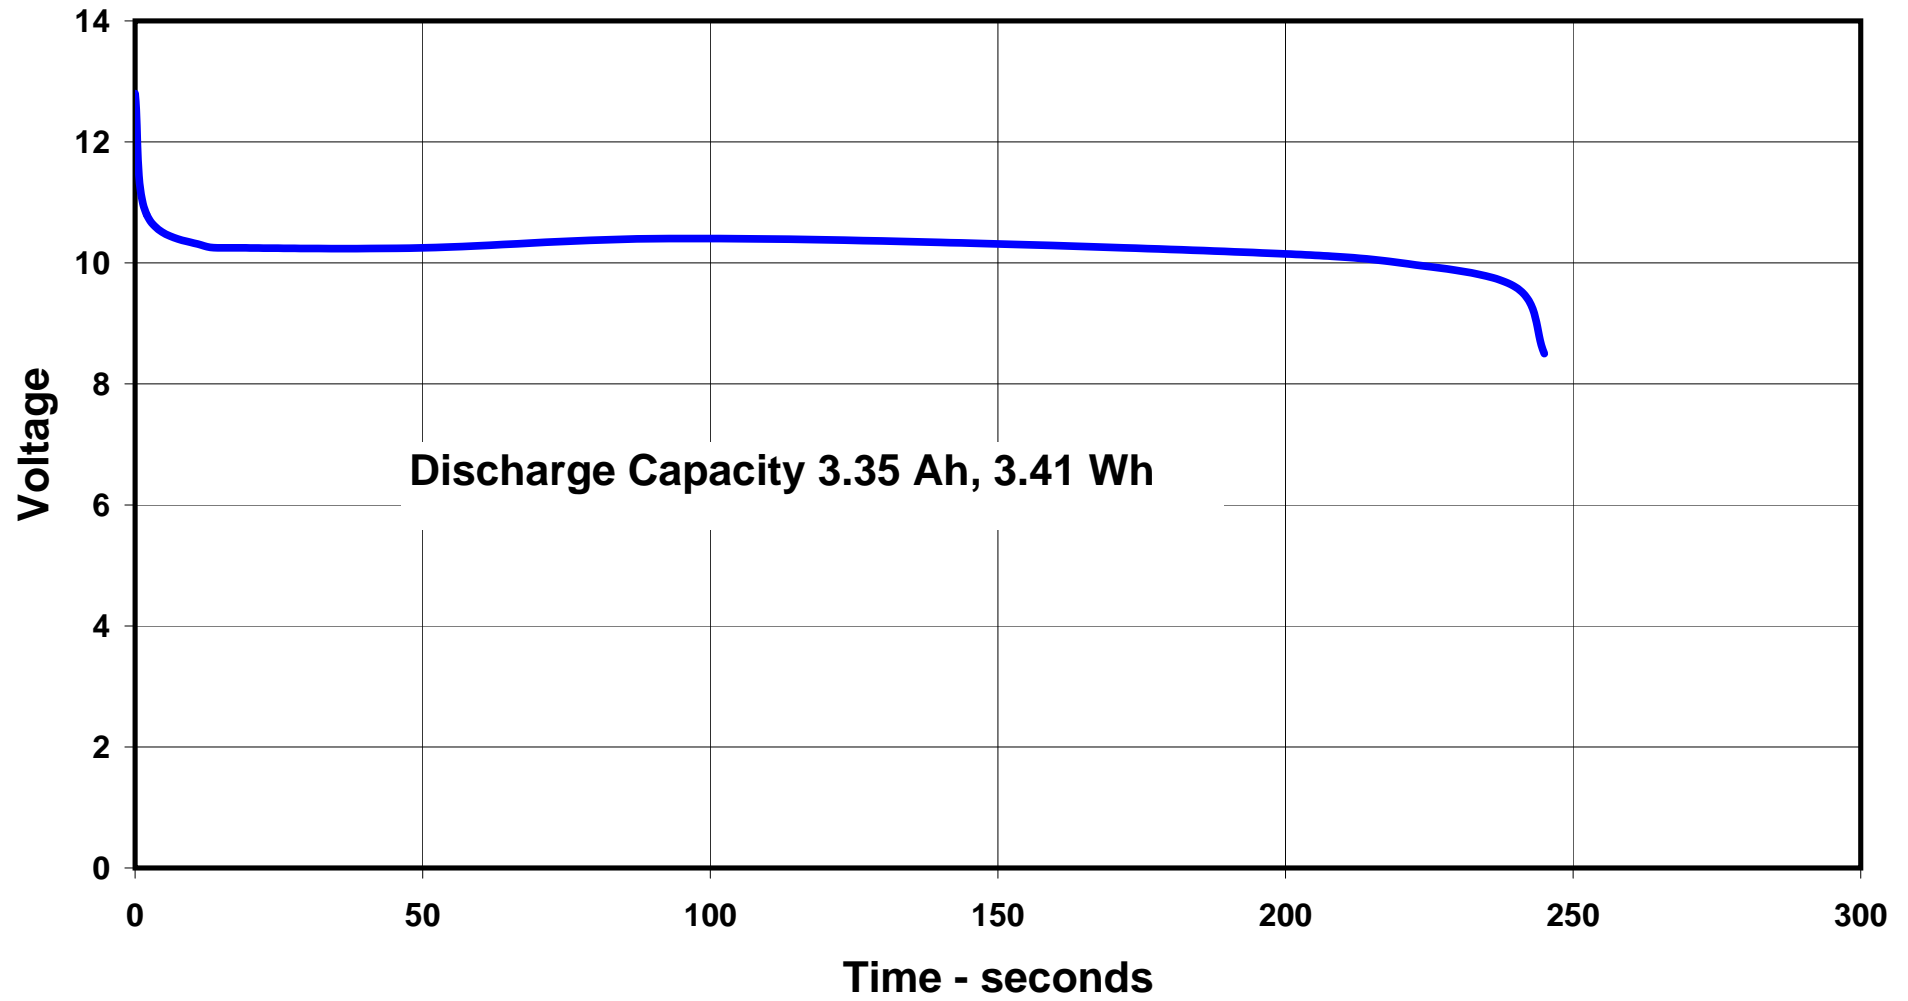

Graph 3 - Discharge of Overlander PolyPro 1500 3S pack at 30 amps/20C

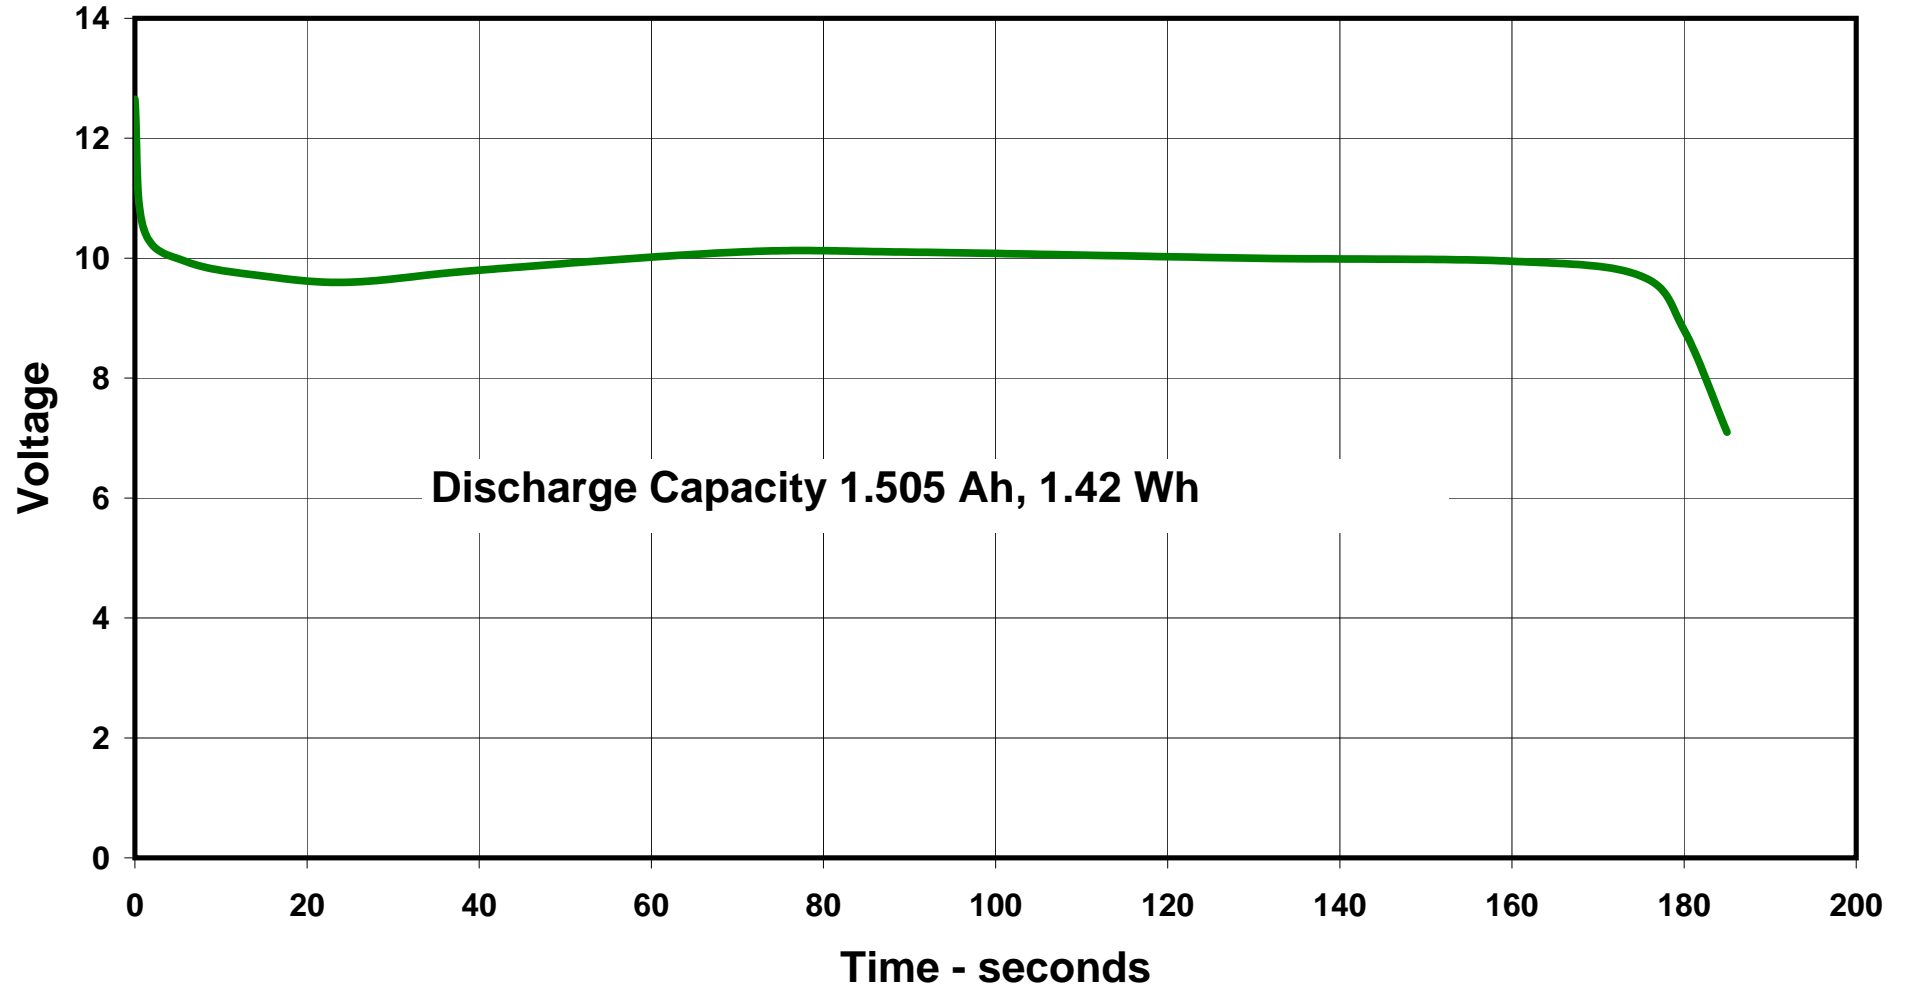

Graph 4 - Discharge of Thunder Power 2.1 Ah 3S LiPo pack at 32 amps/15C

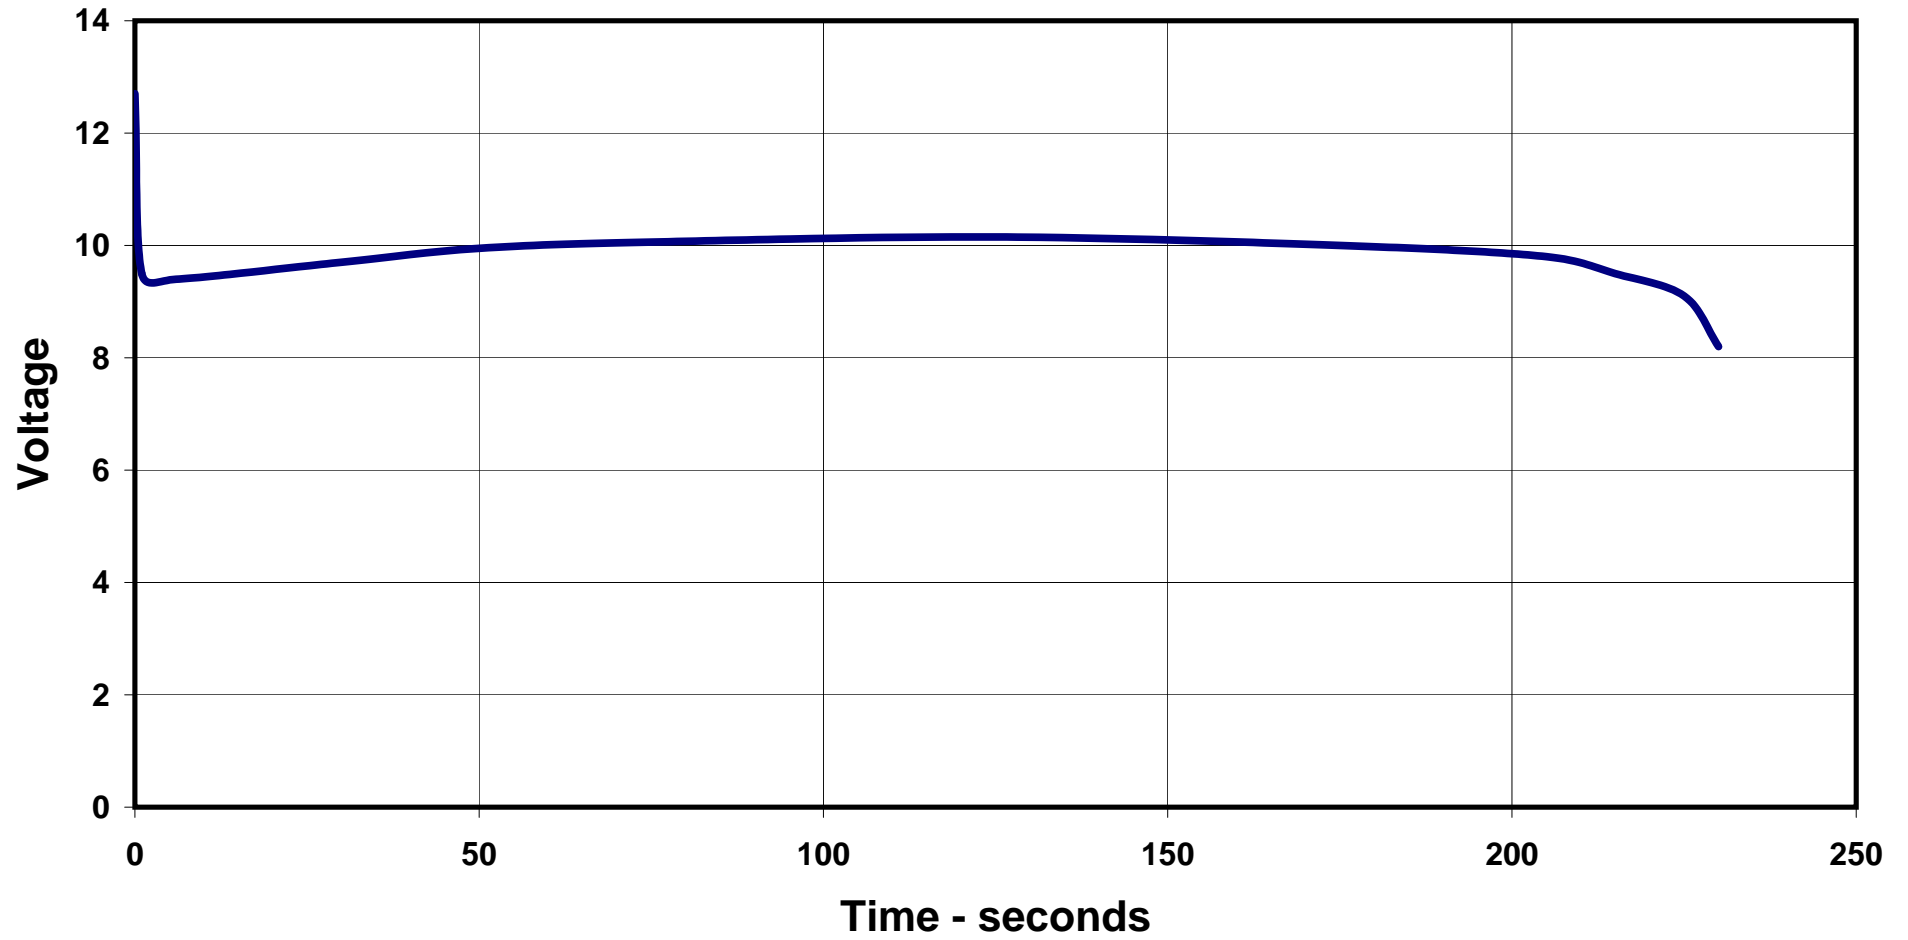

Graph 5 - Discharge of Thunder Power 1.3 Ah 3S LiPo pack at 16 amps/13C

